



Texas Commission on Environmental Quality

CERTIFICATE OF DELIVERY OF PUBLIC NOTICE TO CUSTOMERS: Boil Water Notice

Public Water System (PWS) name: CITY OF WELLS

PWS ID: 0370004 Date of violation(s) or situation(s) October 24, 2024

Type of Total Coliform Rule Ground Water Rule violation(s) or situation:

- Boil Water Notice (BWN) due to: loss of pressure, line break, water outage, or any condition requiring a BWN (includes Rescind Notice)
- Treatment technique violation (Ground Water or Surface Water Treatment Rule)

30 TAC 290.46(q)(1) requires that your PWS make an adequate, good-faith effort to reach all consumers served by the system by appropriate methods (check all below that apply):

COMMUNITY WATER SYSTEM (perform one of the following):

- Provide a copy of the Boil Water Notice to the radio and television stations serving the area surrounding the public water system
- Publish BWN in local newspaper
- Deliver BWN directly to each customer via mass call system
- Post BWN in conspicuous places within the affected area

NONCOMMUNITY WATER SYSTEM (perform one of the following):

- Deliver BWN directly to customers, or
- Post BWN in public places within the area served by the system

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations."

Certified by: (print name): Carl Pennington/Roy Shanks Title: Superintendent

Date of Delivery to Customers: 10/24/2024 Phone: (936) 867-4615

Signature: Date: 10/24/25

Fax to (512) 239-3666 or mail a copy of this completed form, **AND** copies of the Public Notices given to your customers to: TCEQ – Public Drinking Water Section MC – 155, Attn: Public Notice. P. O. Box 13087 Austin, TX 78711-3087

Special Precautions Log

Date 10/24/2024

No Yes

If no, record the PSI at the worst case location(s) affected by the event (such as highest elevation):

| | | |
|--------------|-----|-----------|
| Location | PSI | Initials |
| <u>Homer</u> | | <u>CP</u> |
| Location | PSI | Initials |
| Location | PSI | Initials |

Notes

Location of event(s):

Chlorine Ejector failure

City wide

Locations of flushing and disinfectant residual results:

See flush log

Locations of bacteriological samples:

See Labs

Attach BWN, Certificate of Public Delivery, bacteriological lab samples, BWN rescind notice, and other applicable documentation.

Note 1: If a line break area was contaminated (e.g. sewer main break near it), and system does not utilize slug chlorination, then a BWN should be issued.

Did the water main pressure drop below 20 PSI and was the line partially or fully dewatered?

Yes

Option A

Circle Yes or No and Initial Each Answer

A. Can the mains be disinfected according to AWWA Standards (C651-05) & flushed?

CP Initials Yes No BWN

1. Was the trench treated with calcium hypochlorite?

CP Initials Yes No BWN

2. Were couplings swabbed with sodium hypochlorite?

CP Initials Yes No BWN

3. If slug chlorination is planned, where practical, then:

3.1 Can service connections be shut off?

CP Initials Yes No CP Initials Yes No BWN

3.2 Can the main(s) be isolated?

CP Initials Yes No CP Initials Yes No BWN

3.3 Before slugging, review 4.7 of C651-05. Then list:

Cl2 Concentration Contact Time Initials

3.4 If slugged, then see Appendix C of C651-05 regarding disposal of heavily chlorinated water.

4. Were the main(s) flushed until water was clear?

CP Initials Yes No BWN

5. Were the disinfectant residuals restored to normal?

(List locations and results in notes section.)

CP Initials Yes No BWN

6. Were bacteriological samples taken?

CP Initials Yes No BWN

Option B

B. Issue a Boil Water Notice (BWN) to the customers in the area where the loss of pressure occurred.

1. List BWN method of delivery?

Examples: Door Hanger, Radio, TV, Signs, Call System

Call System Method(s) CP Initials

2. Is BWN notice attached?

Yes No

3. Was Certificate of Public Delivery & BWN faxed to TCEQ?

Yes No

4. Though not required, were lines flushed (recommended)?

Yes No

5. Were bacteriological samples taken? (List locations and results in notes section.)

Yes No

6. Was lab asked to expedite results (fax)?

Yes No

7. Were bacteriologicals negative?

Yes No

7.1 Was BWN left in effect and TCEQ contacted?

Yes No

7.2 Was a BWN rescind notice issued?


Yes No

7.2.1 Were lab results and rescind notice faxed to TCEQ?

Yes No

For further instructions and forms, see: <http://www.tceq.texas.gov/drinkingwater/microbial/notices/boilwater.html>

Carl Perry Operator Signature

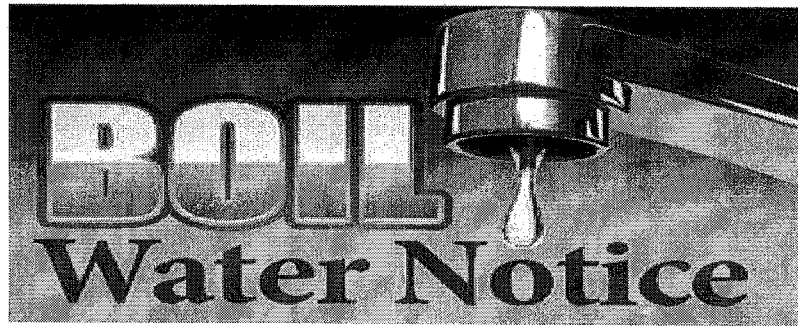

OCTOBER 24, 2024

Due to a CHLORINE PUMP MALFUNCTION, the Texas Commission on Environmental Quality (TCEQ) has required our water system for the CITY OF WELLS ID# 0370004 to notify customers of the need to boil their water before consumption.

This boil water notice will affect **ALL CUSTOMERS ON THE CITY OF WELLS WATER SYSTEM.**

To ensure the destruction of all harmful bacteria and other microbes, water for drinking, cooking, and making ice should be boiled and cooled before use. The water should be brought to a vigorous, rolling boil for two minutes. Instead of boiling, you may purchase bottled water or obtain water from another suitable source.

When boiling the water is no longer necessary, the water system officials will notify you that it is safe for consumption. Instructions to discontinue boiling will be issued in the same manner as this notice.

If you have questions, contact Operator Roy Shanks or City Hall at (936) 867-4615.

If a customer wishes to contact the TCEQ, they may call 512-239-4691.

cityofwells@consolidated.net

From: City of Wells <no-reply@municipalimpact.com>
Sent: Thursday, October 24, 2024 6:37 AM
To: cityofwells@consolidated.net
Subject: Alert from City of Wells

Importance: High

Alert from City of Wells: City Wide Boil Water Notice

Date: Oct 24, 2024

OCTOBER 24, 2024

Due to a CHLORINE PUMP MALFUNCTION, the Texas Commission on Environmental Quality (TCEQ) has required our water system for the CITY OF WELLS ID# 0370004 to notify customers of the need to boil their water before consumption.

This boil water notice will affect ALL CUSTOMERS ON THE CITY OF WELLS WATER SYSTEM.

To ensure the destruction of all harmful bacteria and other microbes, water for drinking, cooking, and making ice should be boiled and cooled before use. The water should be brought to a vigorous, rolling boil for two minutes. Instead of boiling, you may purchase bottled water or obtain water from another suitable source.

When boiling the water is no longer necessary, the water system officials will notify you that it is safe for consumption. Instructions to discontinue boiling will be issued in the same manner as this notice.

If you have questions, contact Operator Roy Shanks or City Hall at (936) 867-4615.

If a customer wishes to contact the TCEQ, they may call 512-239-4691.

To unsubscribe: <https://cityofwells.us/unsubscribe.html?i=20037&e=cityofwells@consolidated.net> .

| END OF THE LINE FLUSH LOG | MONTH: | Flush Time | Date | Start Residual | Finish Residual |
|----------------------------|-----------------------------|------------|-------|----------------|-----------------|
| 2-WAY STOP SIGN | 6TH @ HOMER RD (FH) | | 10/24 | 0.8 | 3.8 |
| CURTIS MCKNIGHT RENT HOUSE | 81 W 6TH ST (FV) | | | | |
| ROSE MARY MOORE | 446 HOMER RD (FH) | | 10/24 | 1.0 | 3.8 |
| TERRY BAILEY | 149 RUSK AVE (FV) | | | | |
| CARL YARBROUGH | 225 US HWY 69 S (FV) | | 10/24 | 0.7 | 4.0 |
| WELLS MANOR APT 1 | 65 MANOR LOOP APT 1 (FH) | | | | |
| WELLS MANOR APT 11 | 90 MANOR LOOP APT 11 (FV) | | | | |
| CARTY WILLIAMS | 258 W 4TH ST (FH) | | | | |
| BILLY BUTLER | 103 W 1ST (FV) | | | | |
| LIFT STATION # 3 | 383 CHAPMAN RD (FH) | | 10/24 | 1.1 | 3.9 |
| JENNIFER PURYEAR | 8306 FM 1247 W (FV) | | 10/24 | 0.7 | 3.8 |
| CLAUDE WARREN JR | 22 WARREN (FV) | | 10/24 | 1.2 | 3.4 |
| DANIEL SCOFIELD | 30 WARREN (FV) | | 10/24 | 0.9 | 3.8 |
| THE RIVER CHURCH | 264 RUSK (FH) | | | | |
| HATHORN RENTAL PROP | 324 RUSK (FV) | | | | |
| MARCIE HULL | 499 RUSK (FH) | | | | |
| AUTOMOTIVE MD | 586 RUSK/FRANK EDGE(FV) | | | | |
| MATT MYER | 118 W FRANK EDGE (FV) | | | | |
| FIRST BAPTIST PREACHER | 66 W OLDHAM (FV) | | | | |
| FIRST BAPTIST CHURCH | 629 RUSK (FV) | | | | |
| LYNDI TARVER | 2347 US HWY 69 S (FV) | | 10/24 | 1.2 | 3.6 |
| WELLS ISD (EVERY SATURDAY) | BONITA/FOURTH SATURDAY (FH) | | 10/24 | 1.1 | 3.8 |
| WELLS ISD (EVERY SATURDAY) | RUSK/5TH SATURDAY (FH) | | 10/24 | 1.0 | 3.9 |
| GERTRUDE HEARNE | 54 E 6TH ST (FV) | | | | |
| ROY BRADLEY | 101 E 6TH/MITCHELL (FV) | | 10/24 | 1.2 | 3.8 |
| HICKS PASTURE | 3846 CR 2631 (FV) | | 10/24 | 1.0 | 3.9 |
| LISA FORD FARM | 1920 CR 2631 (FV) | | 10/24 | 0.9 | 3.8 |
| DENNIS MALNER | 116 MAY (FV) | | | | |
| NANCY BAILEY | 10 MAY ST (FV) | | | | |
| NORMA SHAMNESS | 38 WARNER (FH) | | 10/24 | 1.1 | 3.9 |
| NORMA SHAMNESS | 38 WARNER (FV) FLUSH CHURCH | | | | |
| FIRE HYDRANT | 67 E OLDHAM (FH) | | | | |
| DARREL CRANFORD RENTAL | 446 RUSK (FV) | | 10/24 | 1.0 | 3.8 |
| AGULIION TRAILER | 24 E OLDHAM (FV) | | | | |
| CASSIE SCHROEDER | 24 E GREENVILLE (FV) | | | | |

SEE BACK OF FLUSH SHEET

TCEQ Microbial Reporting Form (TCEQ-10525)

Form Instructions: www.tceq.texas.gov/drinkingwater/microbiol/revise-total-coliform-rule
 Water System Identification & Sample Collection Information (Please print or type the information)

Public Water System ID: TX 0370004

Public Water System Name: City of Wells

Name: City of Wells

Address: PO Box 20

City: Wells

Phone #: (936) 867-4615

State: TX

Zip Code: 75976

PWS Email: cityofwells@consolidated.net

* SAMPLES MARKED AS SPECIAL OR CONSTRUCTION CANNOT BE USED AS ROUTINE OR REPEAT SAMPLES

| Sample Identification/Location | Sample Type (One) | | | Collected | | Chlorine Residual | | Original Sample ID and Date of Collection (Repeat, TSM Raw Well, Replacement) |
|--------------------------------|------------------------|--------|--------------|-------------------|--------------|-------------------|--------------|---|
| | Routine (Distribution) | Repeat | Construction | Date (MM/DD/YYYY) | Time (HH:MM) | Free (mg/L) | Total (mg/L) | |
| G0370004c | | X | | 10-25-24 | 10:45 | 0 | | |
| 314 Chapman Rd./Hansen | | X | | 10-25-24 | 10:58 | 4.0 | | |
| 332 Forrest Rd./Trubian | | X | | 10-25-24 | 10:52 | 4.0 | | |
| 22 Warren Rd./Warren | | X | | 10-25-24 | 10:59 | 2.0 | | |
| 781 Busk Ave./Hodges | | X | | 10-25-24 | 11:04 | 1.5 | | |
| 75 May St./Murray house | | X | | 10-25-24 | 11:21 | 1.5 | | |
| 199 Busk Ave./Wells ISD | | X | | 10-25-24 | 11:27 | 1.5 | | |
| 105 S. Lillian St./Horn | | X | | 10-25-24 | 11:41 | 2.5 | | |



Eastex Environmental Laboratory, Inc. - Nacogdoches
 1119 S University Dr
 Nacogdoches, TX 75961
 Phone: (936) 569-8879
 Email: eelnac@sbcglobal.net

TCEQ Laboratory ID: T104704316

Temperature (°C): 27.0
 Corrected Temp: 27.0
 Actual Temp: 27.0

Incubation Date and Time: 10/25/24 13:20
 Analyst: [Signature]
 End Date and Time: 10/26/24 07:40
 Analyst: [Signature]

Lab Rejected Code (LR) - Document Reason: [Blank]

Result Reporting and Approval: [Signature] Date: 10/28/24 Time: 08:35

Analysis Results meet all accreditation requirements unless stated otherwise

Test Method: SM 9223B

Chlorine Check: Present Absent Present Absent Present

Total Coliform: Present Absent Present Absent Present

E. coli: Present Absent Present Absent Present

Laboratory Sample ID Number: N4J1205 01 - 08

Station Code (if applicable) - Recollect: [Blank]

Sampler Name (Print): Roy Shanks

Sampler Email: cityofwells@consolidated.net

Relinquished By Sampler: [Signature]

Relinquished By Courier: [Signature]

Sampler Signature: [Signature]

Sampler Phone #: (936) 229-6700

Operator License # (if applicable): WG0020875

Date and Time: 10/25/24 12:24

Date and Time: 10/25/24 17:35

Received By Counter (if applicable): [Blank]


Received By Lab: [Signature]

Date and Time: 10/25/24 17:35

TCEQ-10525 (Rev. 08/2023)

TCEQ Water Supply Division - (512)-239-4691

Page 1 of 1

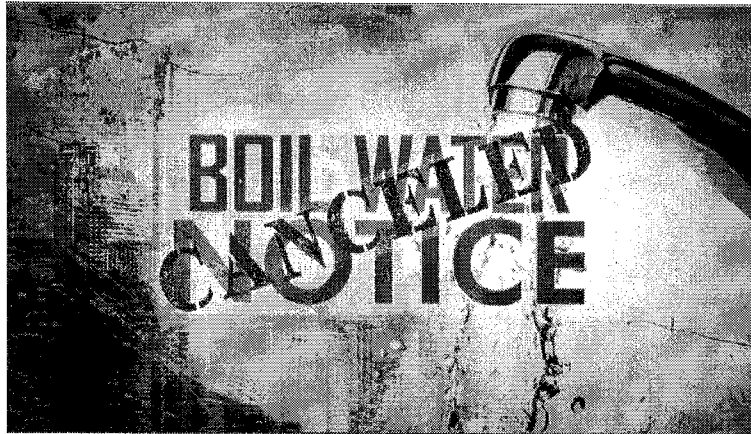

OCTOBER 24, 2024

Due to a CHLORINE PUMP MALFUNCTION, the Texas Commission on Environmental Quality (TCEQ) has required our water system for the CITY OF WELLS ID# 0370004 to notify customers of the need to boil their water before consumption.

This boil water notice will affect **ALL CUSTOMERS ON THE CITY OF WELLS WATER SYSTEM.**

Our system has taken the necessary corrective actions to restore adequate pressure, disinfectant levels, and bacteriological quality and has provided TCEQ with testing results that indicate that the water no longer requires boiling as of **October 26, 2024.**

If you have questions concerning this matter, you may contact Roy Shanks, Operator, or City hall at (936) 867-4615.

If a customer wishes to contact the TCEQ, they may call. (512) 239-4691

Alert from City of Wells: Boil Water Notice Lifted

Date: Oct 26, 2024

[Click link for more information](#)

October 24, 2024

Due to a CHLORINE PUMP MALFUNCTION, the Texas Commission on Environmental Quality (TCEQ) has required our water system for the CITY OF WELLS ID# 0370004 to notify customers of the need to boil their water before consumption.

This boil water notice will affect ALL CUSTOMERS ON THE CITY OF WELLS WATER SYSTEM.

Our system has taken the necessary corrective actions to restore adequate pressure, disinfectant levels, and bacteriological quality and has provided TCEQ with testing results that indicate that the water no longer requires boiling as of October 26, 2024.

If you have questions concerning this matter, you may contact Roy Shanks, Operator, or City hall at (936) 867-4615.

If a customer wishes to contact the TCEQ, they may call. (512) 239-4691
